




Ball Joint Water Meters & Flat Face Meter Unions Installation Instructions

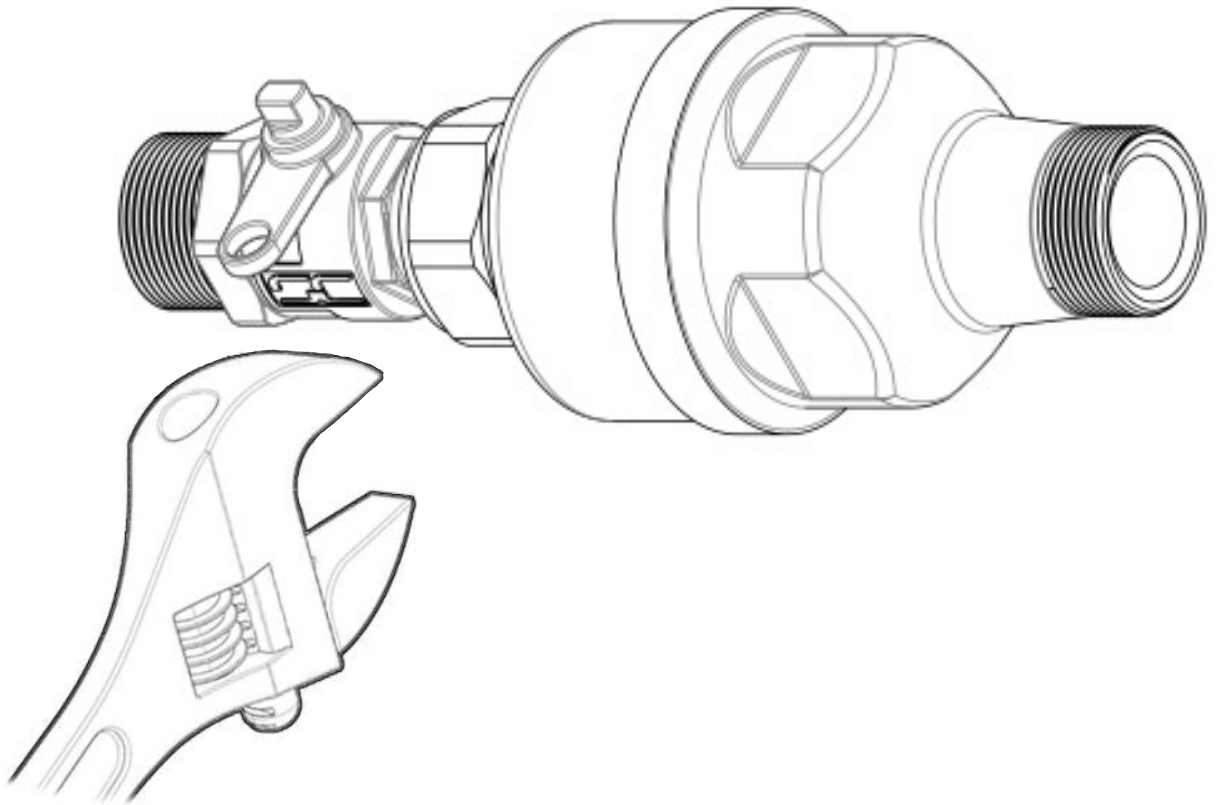

Flat faced meter unions are to be tightened between 9Nm and 15Nm which equates to a quarter to half a rotation with a spanner after being hand tightened.

Do not exceed 18Nm to avoid damage or breach of seal.

This has been tested up to 2400kPa without leakage or signs of distortion of the meter gasket.